



PV & cabinet layout design

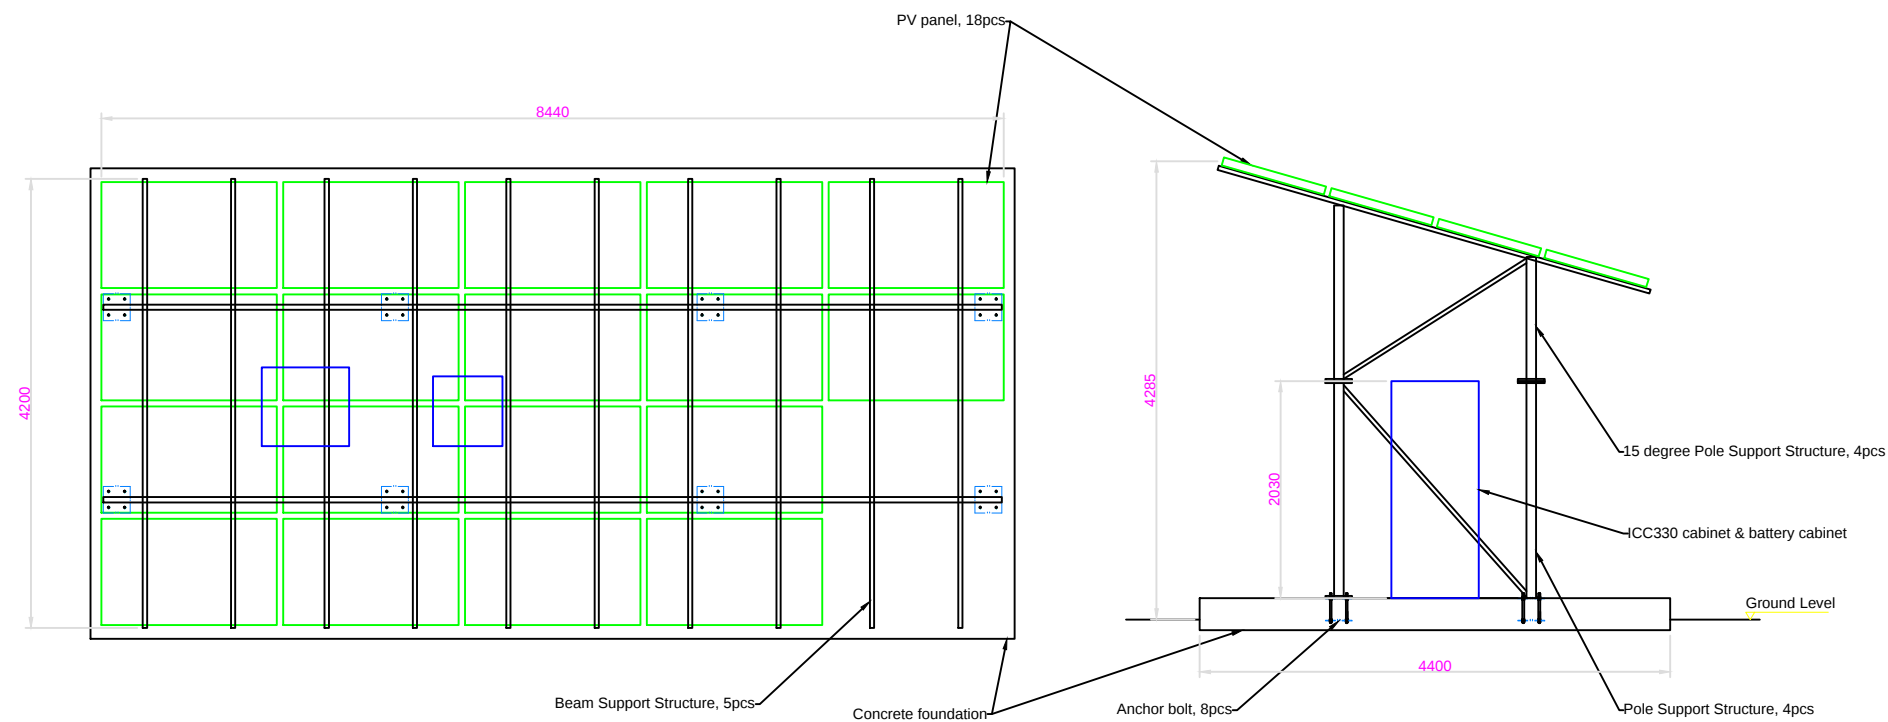

Foundation design

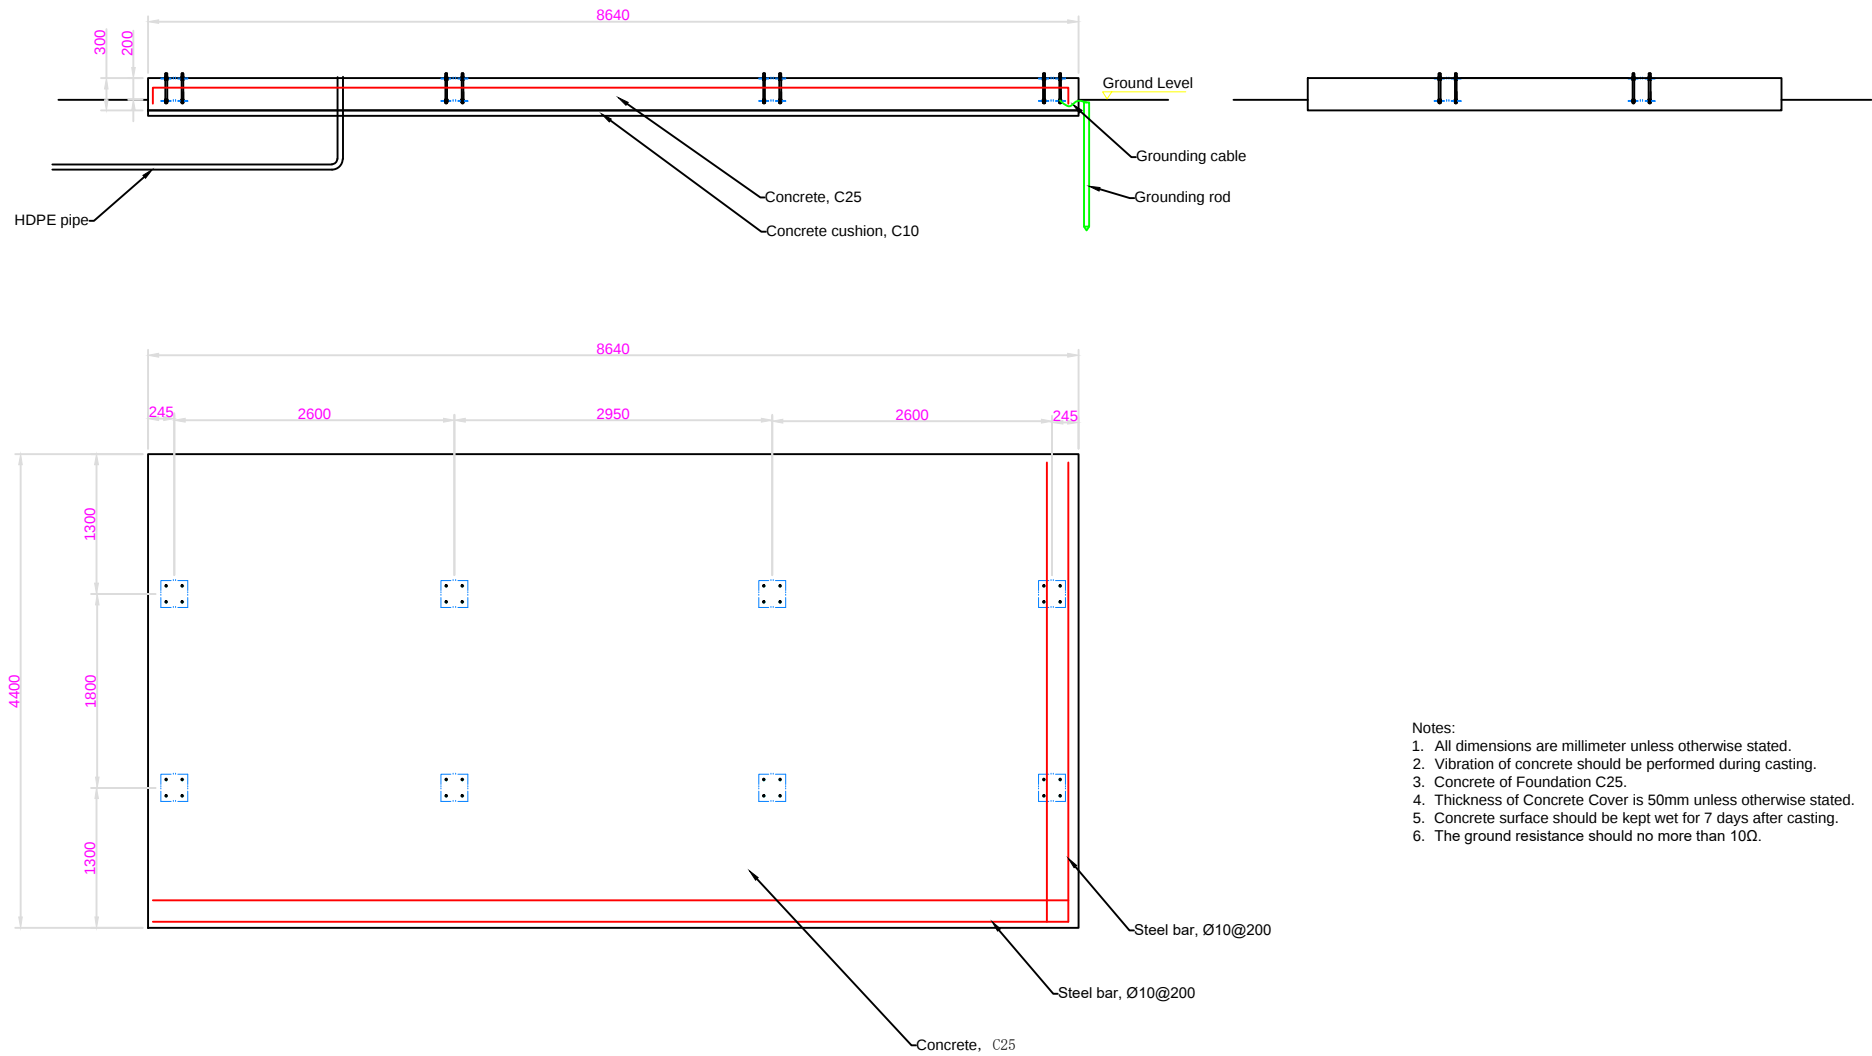

Notes:

1. All dimensions are millimeter unless otherwise stated.
2. Vibration of concrete should be performed during casting.
3. Concrete of Foundation C25.
4. Thickness of Concrete Cover is 50mm unless otherwise stated.
5. Concrete surface should be kept wet for 7 days after casting.
6. The ground resistance should no more than 10Ω.